


CONDENSED INSTALLATION (3+ DEVICES)


CONDENSED INSTALLATION (UP TO 2 DEVICES)

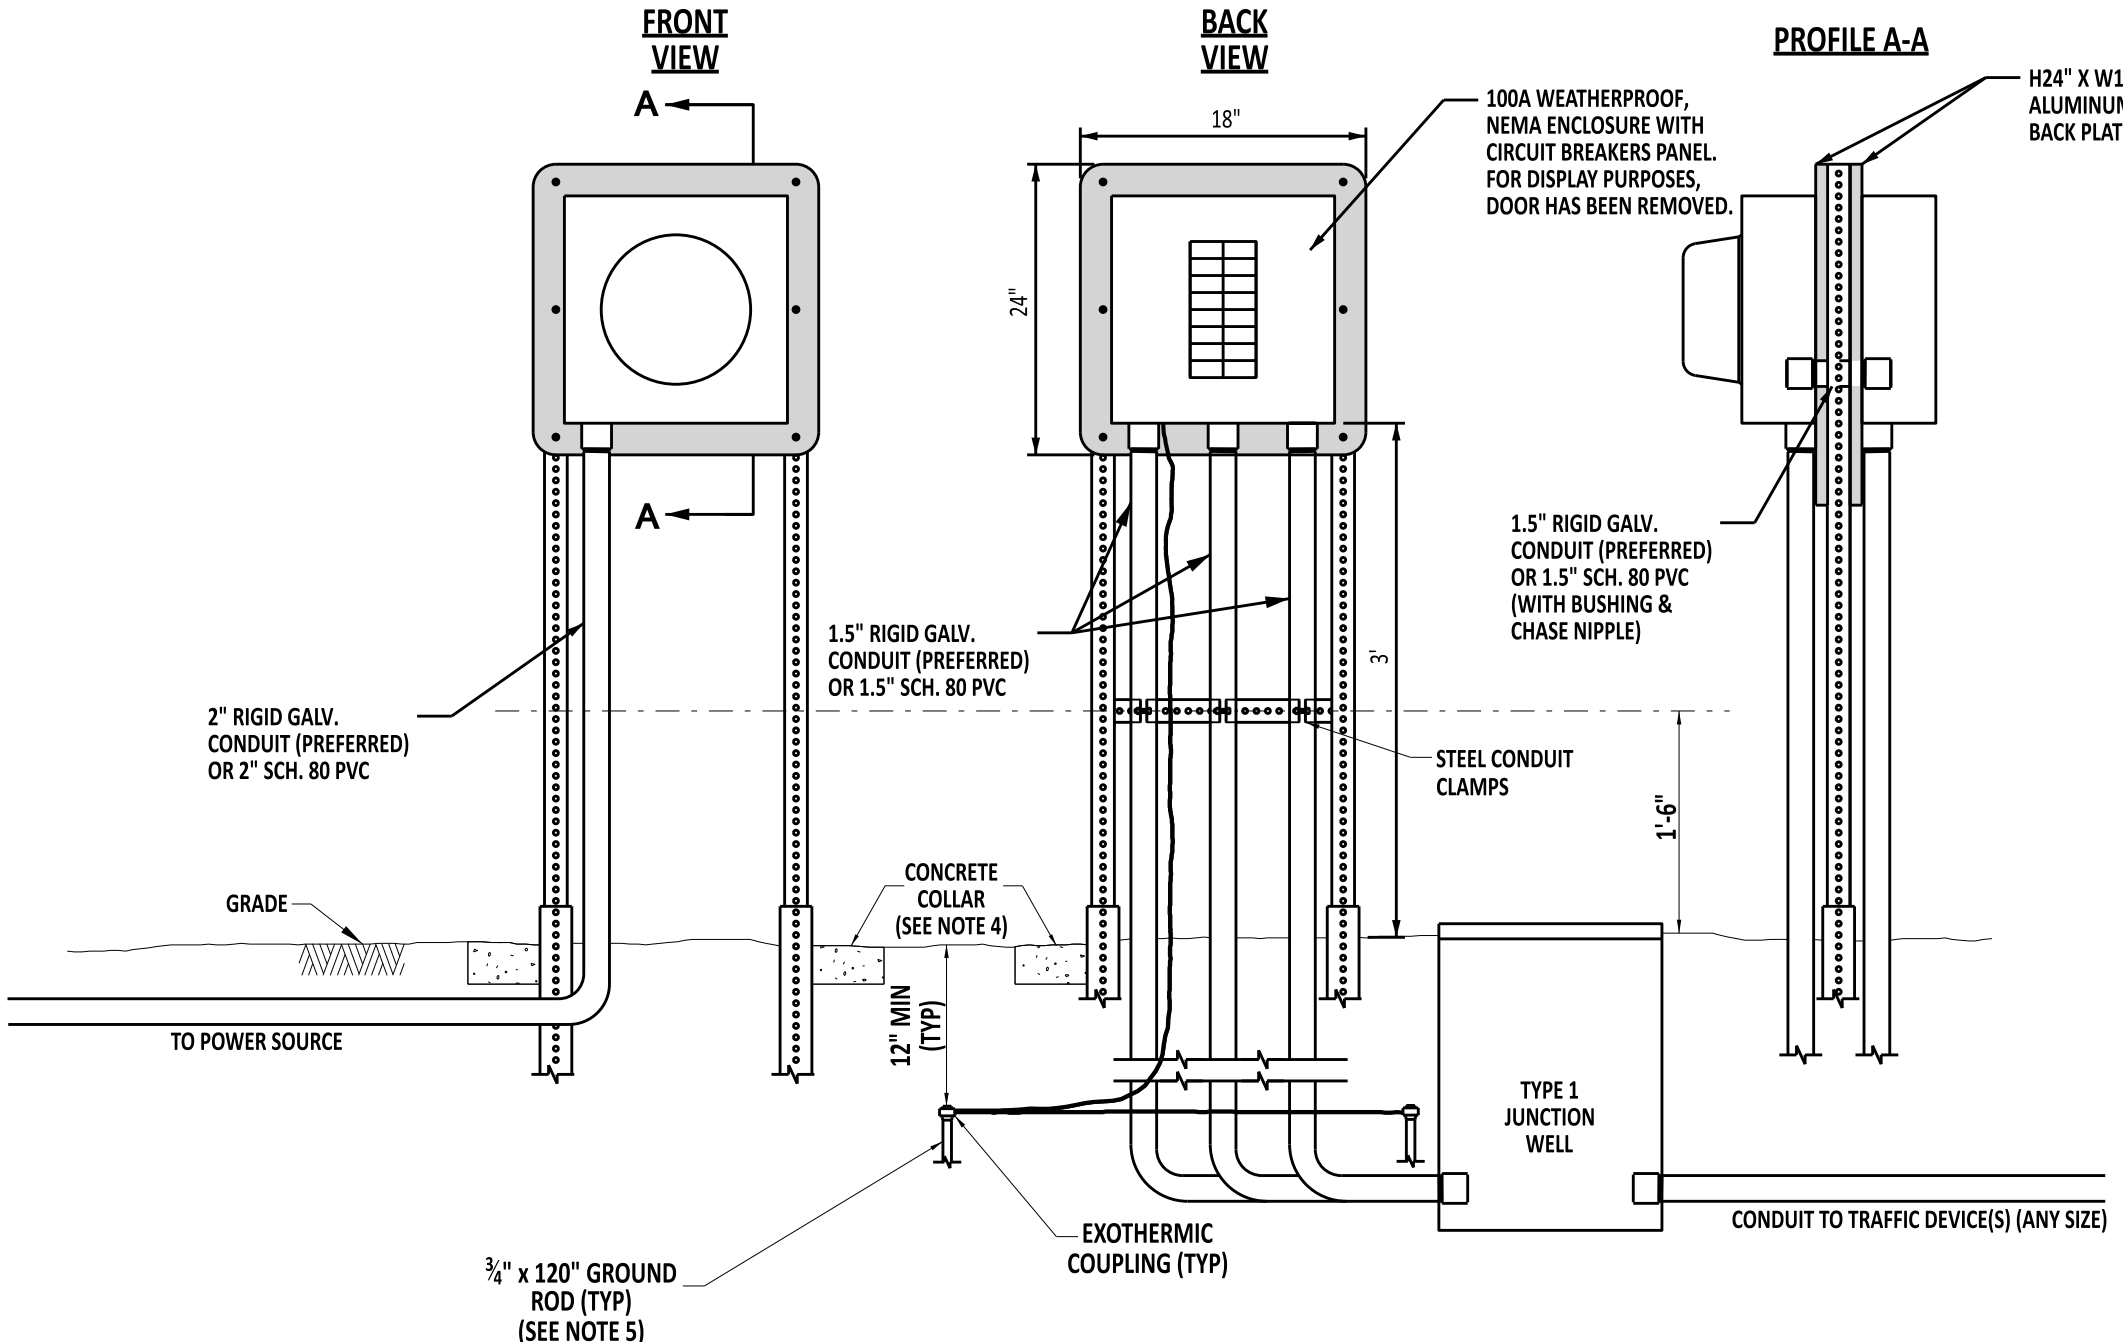

NOTES

- 1.) PEDESTAL SHALL BE USED WHEN ALL DEVICES ARE CLOSE TO POWER SOURCE.
- 2.) PEDESTAL SHALL BE 5 FEET FROM JUNCTION WELL.
- 3.) TO BE USED FOR 3 OR MORE DEVICES WITHIN CONDENSED SPACE.
- 4.) CONCRETE COLLAR SHALL CONTAIN 25 LBS OF CONCRETE AT EACH LEG JUST BELOW GRADE AS DIRECTED BY INSPECTOR.
- 5.) GROUND ROD SPREAD SHALL BE TWICE THE LENGTH OF THE GROUND ROD.

PROFILE A-A

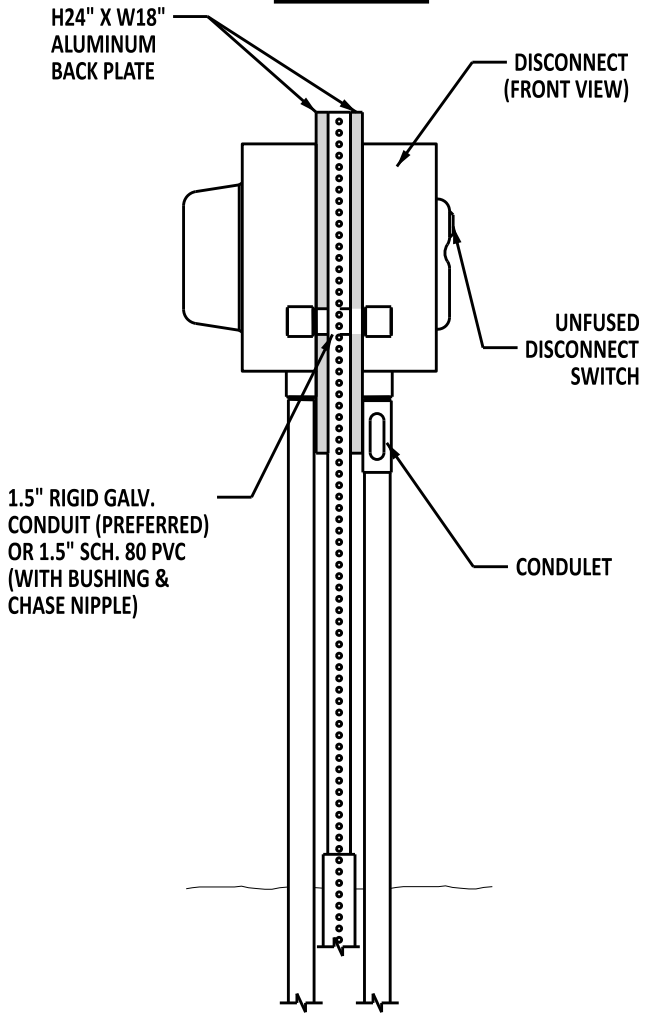

SPECIALTY DISCONNECT TYPICAL

NOTES

- 1.) TO BE USED FOR 2 OR LESS DEVICES WITHIN CONDENSED SPACE.

	<p><i>Andrew Sholt</i> ENGINEERING SUPPORT 12/13/2022 DATE</p> <p>RECOMMENDED</p>	<p>ELECTRICAL SERVICE PEDESTAL - SIGNAL & ITS COMPONENT INSTALLATIONS - 100 AMP (CONDENSED)</p> <p>STANDARD NO. T-17 (2022)</p> <p>SHT. 2 OF 7</p>	<p>REVIEWED <i>[Signature]</i> 12/16/2022 DEPUTY DIRECTOR - DESIGN DATE</p> <p>APPROVED <i>[Signature]</i> 12/21/2022 CHIEF ENGINEER DATE</p>
--	---	--	---